
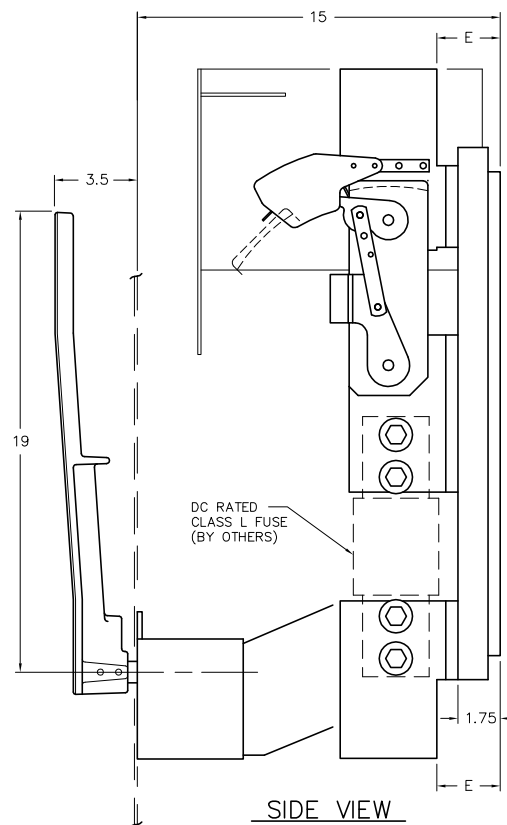
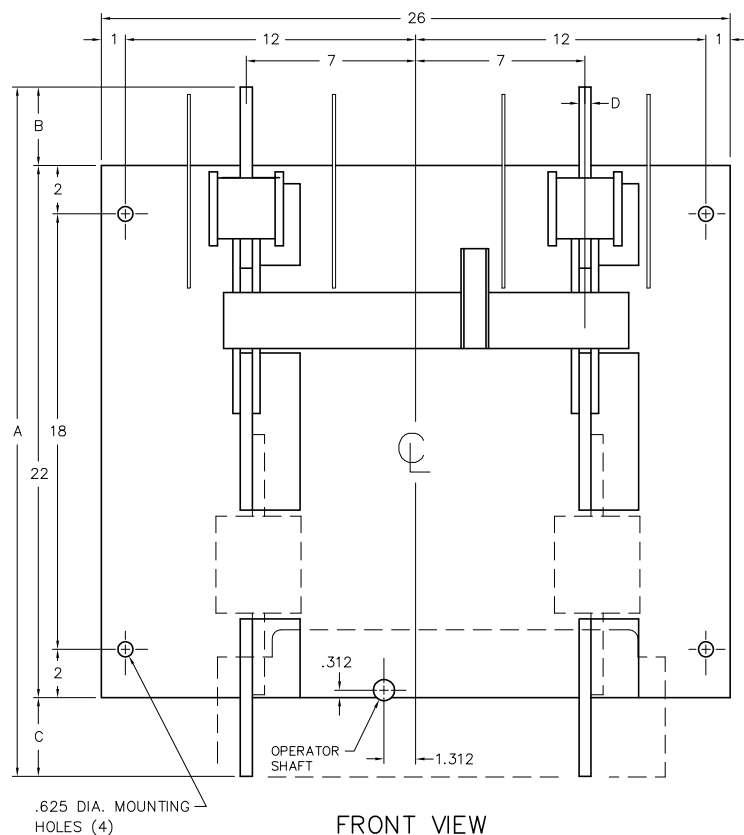


VENTILATION

WHEN THE SWITCH IS TOTALLY ENCLOSED, VENTILATING LOUVERS MUST BE PROVIDED YIELDING A MINIMUM OPEN AREA OF "H" SQUARE INCHES NEAR THE TOP OF THE ENCLOSURE, AND "H" SQUARE INCHES NEAR THE BOTTOM OF THE ENCLOSURE.

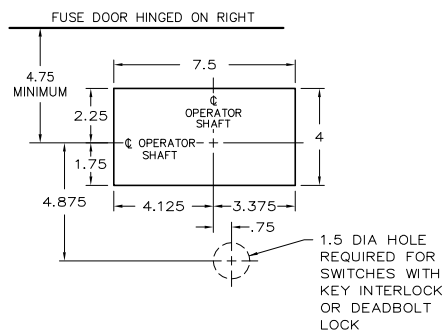

OPERATOR DETAILS

FOR OPERATOR DETAILS AND ALTERNATE FRONT CUT-OUTS, REFER TO THE FOLLOWING DRAWINGS:

- O-1023A MANUAL OPERATOR
- O-1090A SHUNT TRIP OPERATOR

KEY INTERLOCK

KEY INTERLOCK SPECIFICATIONS FOR SWITCHES EQUIPPED WITH KEY INTERLOCK PROVISIONS ARE:

- .375 BOLT PROJECTION WHEN WITHDRAWN
- KIRK TYPE B
- SUPERIOR TYPE B6003

AMP	CATALOG NUMBER*	NET WT.	A	B	C	D	E	H
800	VLDC267	107 LBS	25.75	2	1.75	.375	2.5	NONE
1200	VLDC268	114 LBS	28.5	3.25	3.25	.375	2.5	NONE
1600	VLDC269	116 LBS	28.5	3.25	3.25	.375	2.5	60 SQ. IN.
2000	VLDC2610	133 LBS	28.5	3.25	3.25	.5	2.625	60 SQ. IN.

* OPTIONAL SHUNT TRIP, ADD SUFFIX -ST

SERIES VLDC

800-2000 AMP, 2-POLE, 600 VOLT DC
CLASS L FUSIBLE SWITCH

SCALE:	APPROVED BY:	DRAWN BY JAE
DATE: 7-21-92		REVISED 2

boltswitch, inc.
CRYSTAL LAKE, ILLINOIS 60014

DRAWING NUMBER
O-1521

REV 2 11-8-95 JAE NEW FRONT CUT-OUT, HANDLE STYLE & LOCATION REVISED
REV 1 7-28-94 JAE KEY INT CHANGED